

FM-200[®] Component Description

Cylinder and Valve Assembly 125 lb. (56.7 kg) Capacity





Effective: April 2002

K-90-2030

FEATURES

- For use with UL Listed, ULC Listed and FM Approved Systems

P/N: 90-10012X-001

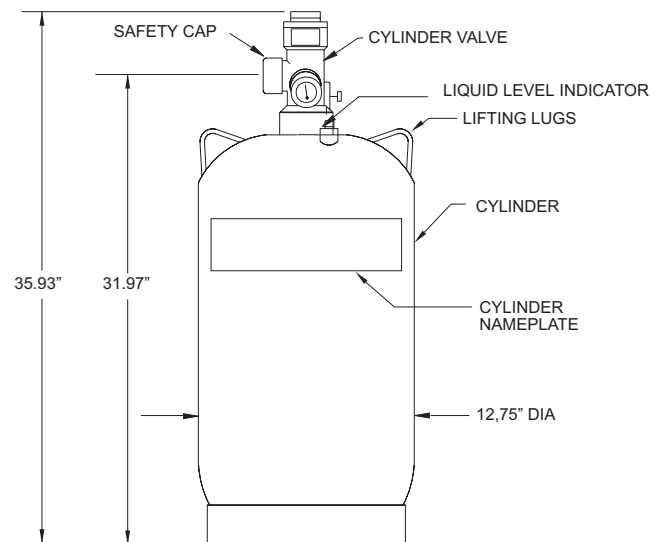

ORDERING INFORMATION

Part Number	Description
90-100121-001	w/LLI
90-100125-001	STD

MATERIALS

- Valve Body: Brass
- Cylinder: Steel, Painted Red

Note:

1. The safety cap must be installed on the valve outlet at all times, except when the cylinders are connected to the system piping, or being filled. The safety cap must not be removed from its chain.
2. See K-90-2020 for additional information.

FM-200 is a registered trademark of the Great Lakes Chemical Corporation.

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly. If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL INC., Ashland, MA 01721. Telephone: (508) 881-2000

Kidde Fire Systems
400 Main Street
Ashland, MA 01721 USA
Tel: (508) 881-2000
Fax: (508) 881-8920
<http://www.kiddefiresystems.com>